LBL-13290 c.2

Lawrence Berkeley Laboratory
UNIVERSITY OF CALIFORNIA

ENERGY & ENVIRONMENT DIVISION

To be presented at the American National Standards Institute Meeting, Subcommittee C82-1 on Fluorescent Lamp Ballasts, Chicago, IL, September 15-16, 1981

HIGH-FREQUENCY STARTING OF FLUORESCENT LAMPS

Oliver C. Morse

RECEIVED
LAWRENCE
BERKELEY LABORATORY

OCT 13 1981

LIBRARY AND
DOCUMENTS SECTION

September 1981

TWO-WEEK LOAN COPY

This is a Library Circulating Copy which may be borrowed for two weeks. For a personal retention copy, call Tech. Info. Division, Ext. 6782

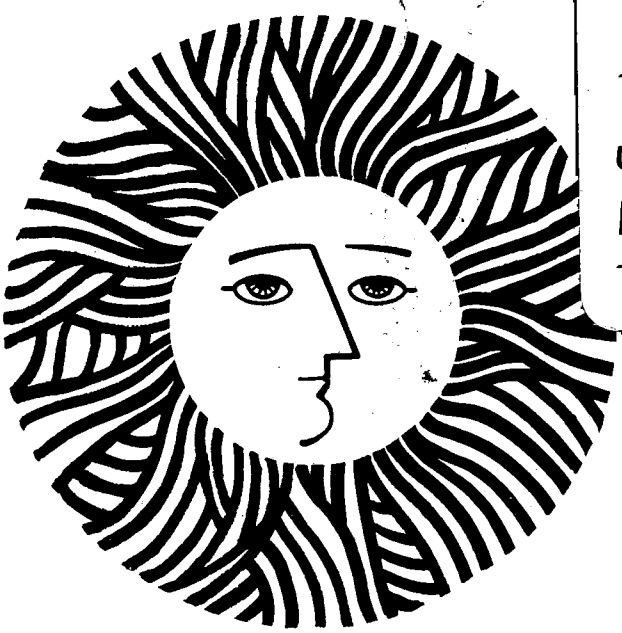

LBL-13290 c.2

Prepared for the U.S. Department of Energy under Contract W-7405-ENG-48

DISCLAIMER

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor the Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or the Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof or the Regents of the University of California.

LBL-13290
EEB-L-81-10
L-53

Paper to be presented at the American National Standards Institute Meeting, Subcommittee C82-1 on Fluorescent Lamp Ballasts, Chicago IL, September 15 & 16, 1981.

HIGH-FREQUENCY STARTING OF FLUORESCENT LAMPS

Oliver C. Morse

Lighting Systems Research
Lawrence Berkeley Laboratory
University of California
Berkeley CA 94720

SEPTEMBER 1981

The work described in this paper was supported by the Assistant Secretary for Conservation and Renewable Energy, Office of Building Energy Research & Development, Building Equipment Division of the U.S. Department of Energy under Contract No. W-7405-ENG-48.

This manuscript was printed from originals provided by the author.

ABSTRACT

Lamp and ballast manufacturers have shown increasing interest in having a high-frequency testing procedure to determine the peak and rms starting voltages for fluorescent lamps. This paper discusses a starting voltage procedure and typical test results for a single-lamp circuit. These peak/rms relationships are shown as a function of frequency, cathode voltage, and ambient temperature for three types of "F40" lamps (the standard F40, the F40 35-watt and the F40 35-watt without a conductive coating).

1.0 INTRODUCTION

E.E. Hammer[1] has recently done some experimental work to determine starting requirements for 60-Hz fluorescent lamps. He has measured two starting parameters, a peak voltage (Vp), (the high potential from cathode to the external starting aid), and an rms voltage (Va) requirement across the lamp. Electronic ballasts may present new starting requirements because they operate at between 20 kHz and 50 kHz. This study was made over a wider range of frequencies (60 Hz - 100 kHz), in the event other operating frequencies become more desirable. This paper describes an experiment with three types of "F40" lamps:

1. the standard F40, T-12 rapid-start lamp;

2. the F40 (35-watt) T-12 rapid-start lamp;

3. the F40 (35-watt) T-12 rapid-start lamp without internal starting aid (no internal conductive coating).

We will present data for the above frequency range in ambient temperatures of 10°C and 25°C.

2.0 PROCEDURES

2.1 Circuit

Figure 1 is a schematic of the electrical circuit used for measuring the peak breakdown voltage (Vp) of the lamps. The starting aid is 1" wide and is 1/2" from the lamp. Cathode heat is supplied at 60 Hz for all test frequencies because the error introduced was considered negligibly small and did not justify the logistical difficulties of supplying high-frequency cathode heat.

E.E. Hammer, 1981, "Peak and RMS Starting Voltage Procedure for Standard/Low Energy Fluorescent Lamps," Journal of the Illuminating Engineering Society 10(4):204.

2.2 Breakdown Observation

The nature of the breakdown phenomenon varies widely as a function of applied frequency and lamp type. At 60 Hz the admittance of the lamp is greater than that of the inherent capacitance between the lamp and the starting aid. Therefore, the entire length of the lamp glows when Vp is reached. At frequencies greater than 10 kHz, the capacitive admittance "shorts out" the voltage at the middle of the lamp, and only the ends glow.

At intermediate frequencies, both phenomena can occur at different voltages. The end glow occurs at lower voltages, and is extremely difficult to detect. The circuit depicted in Figure 1 includes a very sensitive bridge circuit that detects end glow. With applied voltage set well below Vp, R_1 and C_1 are adjusted for minimum signal on the oscilloscope. When breakdown occurs, the lamp becomes nonlinear, and distorts the current waveform in that leg of the bridge. At intermediate frequencies, the breakdown can be very subtle and gradual.

2.3 Peak Voltage

To determine Vp, the Vp voltage source was gradually increased until a change in the waveshape occurred. For intermediate frequencies a subtle change occurred at a lower voltage (end glow) and at a higher voltage, a much more obvious change occurred. Both voltages were recorded.

2.4 Rms Voltage

Figure 2 shows the circuit for finding the rms breakdown voltage V_A. This circuit permits independent control of all three voltage sources, V_k, V_p, and V_A where V_k is the cathode voltage. The phase-lock generator is not necessary at 60 Hz because the power mains are of one coherent frequency. At other frequencies, the phase-lock generator is necessary to make the Vp and Va sources coherent.

The ballast resistor was adjusted for a lamp current of 0.43 A with 236 volts applied to the lamp and ballast in series. This is

similar to the ANSI 236-volt reference circuit except that a resistor is used instead of an inductor. The impedance of the resistor is relatively constant over the frequency range of interest.

To find the rms breakdown voltage Va, first apply at least twice the value of Vp between the high-potential cathode and the starting aid. Gradually increase the Va voltage source, carefully monitor the voltage across the lamp, and note when the lamp voltage reaches a maximum, then starts to decrease. This maximum lamp voltage is Va, at which the transition from abnormal glow to arc mode occurs.

3.0 RESULTS

Figures 3 through 6 show the values of V_p and V_A for the three types of lamps at 10°C and 25°C ambient. Although data for cathode heat voltages of 2.5, 3.6, and 4.0 were obtained, only that for 3.6V is presented here because there was little change in results for the other two values of cathode heat voltages. Experimental 60 Hz data by Hammer[1] is included on the graphs where possible.

4.0 DISCUSSION

The most salient results of this experiment are the high V_p requirements of uncoated 35-watt lamps at 60 Hz and the high V_A requirements of coated 35-watt lamps at high frequencies. The internal conductive coating, which was furnished for improving 60-Hz starting, turns out to be detrimental at high frequencies.

The peak breakdown voltage, V_p, between the high potential cathode and the external starting aid varies significantly as a function of lamp type, frequency, and ambient temperature. At 60 Hz, the uncoated 35-watt lamp requires 370 volts versus 160 volts for the internally coated lamp. The internal coating intensifies the electric field near the ends of the lamp, thereby permitting a lower overall applied starting voltage. At higher frequencies, the internal starting aid still reduces the V_p requirement, but to a lesser extent. For the 40-watt lamp, the V_p versus frequency graphs are confusing between 1 kHz and 8 kHz. It was difficult to observe breakdown phenomena in this range on the 40-

watt lamp. End glow was obscured by the cathode heat glow, and could only be inferred from the change of waveshape on the oscilloscope.

The internal conductive coating on the 35-watt lamp increased the rms breakdown voltage, V_A, from 125 volts to 200 volts at 60 Hz, and from 100 volts to 270 volts at 30 kHz. The conductive coating is capacitively coupled to the arc, and tends to short out the voltage across the lamp. The higher the frequency, the greater the capacitive coupling and accompanying increase in V_A requirements. The V_A requirements are relatively independent of frequency for the 40-watt lamp.

An increase in ambient temperature lowered the V_p and V_A requirements in most cases. The overall frequency range of operation is of interest for future designs when ballasts can be made efficiently for operation at higher frequencies. The three potential frequency ranges in use today are 50-60 Hz (power mains), 400 Hz (aircraft), and 20 - 50 kHz (solid-state ballasts). Frequencies between 400 Hz and 20 kHz are undesirable because of audible noise.

Data were taken for cathode heat voltages of 2.5, 3.6, and 4.0 volts. These voltages are minimum, rated, and maximum voltages per ANSI. There was so little variation in the results over this range of cathode voltage that only the data for 3.6 volts have been measured. Experimental results by Hammer[1] also show very little change for this range of cathode voltages.

5.0 CONCLUSIONS

The starting peak voltage requirement is lower at frequencies above 10 kHz for the F40-watt lamps. The conductive coating for the F40 (35-watt) lamps is needed so that the 60-Hz ballast will start the lamps at a reasonable voltage. The rms starting voltage increases with frequency for the coated F40 (35-watt) lamps. At high frequency the peak and rms voltage requirements are least for an uncoated F40 (35-watt) lamp.

6.0 ACKNOWLEDGEMENTS

The author would like to thank E.E. Hammer of the General Electric Company for helpful advise and for providing the uncoated 35-watt lamps.

The work described in this paper was supported by the Assistant Secretary for Conservation and Solar Energy, Office of Building Energy Research & Development, Building Equipment Branch of the U.S. Department of Energy under Contract No. W-7405-ENG-48.

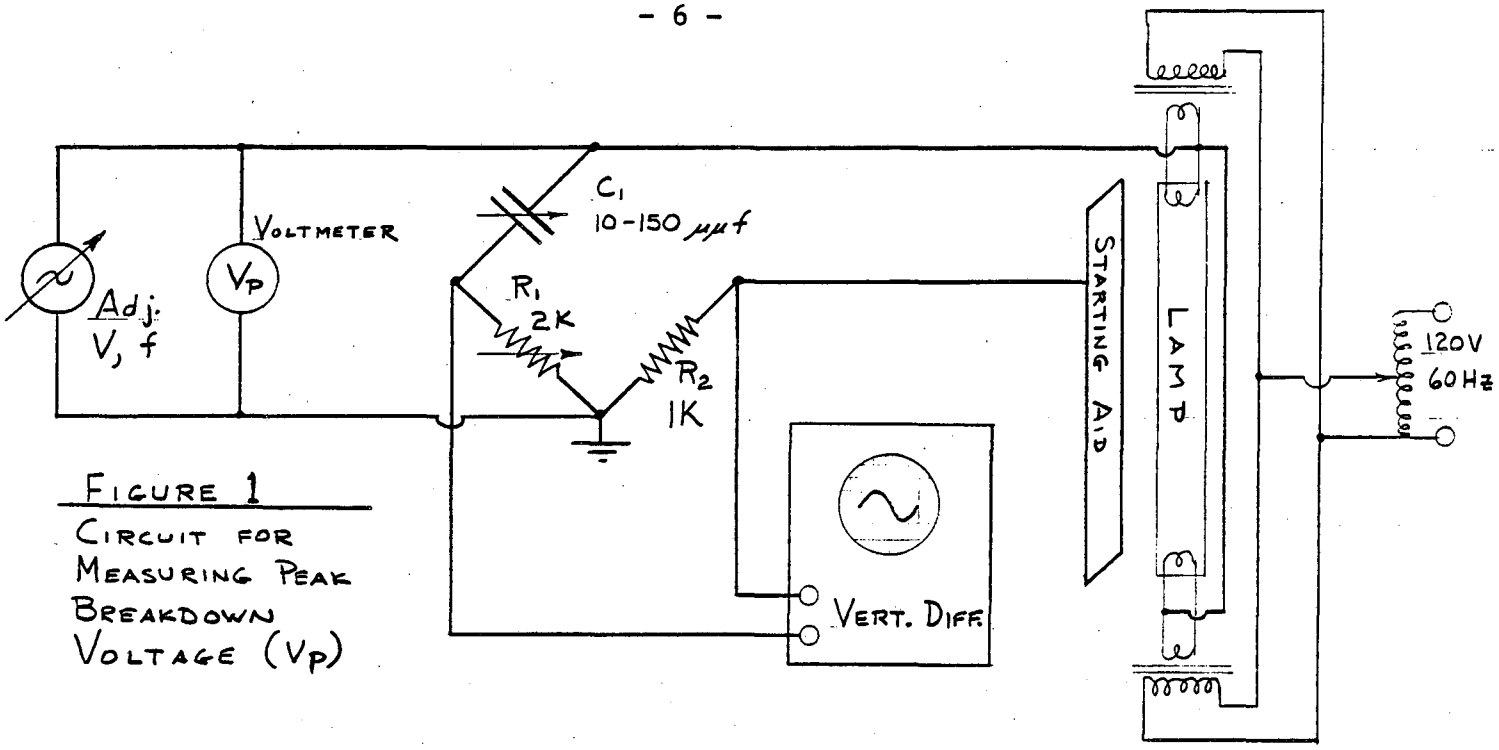

FIGURE 1

CIRCUIT FOR MEASURING PEAK BREAKDOWN VOLTAGE (V_P)

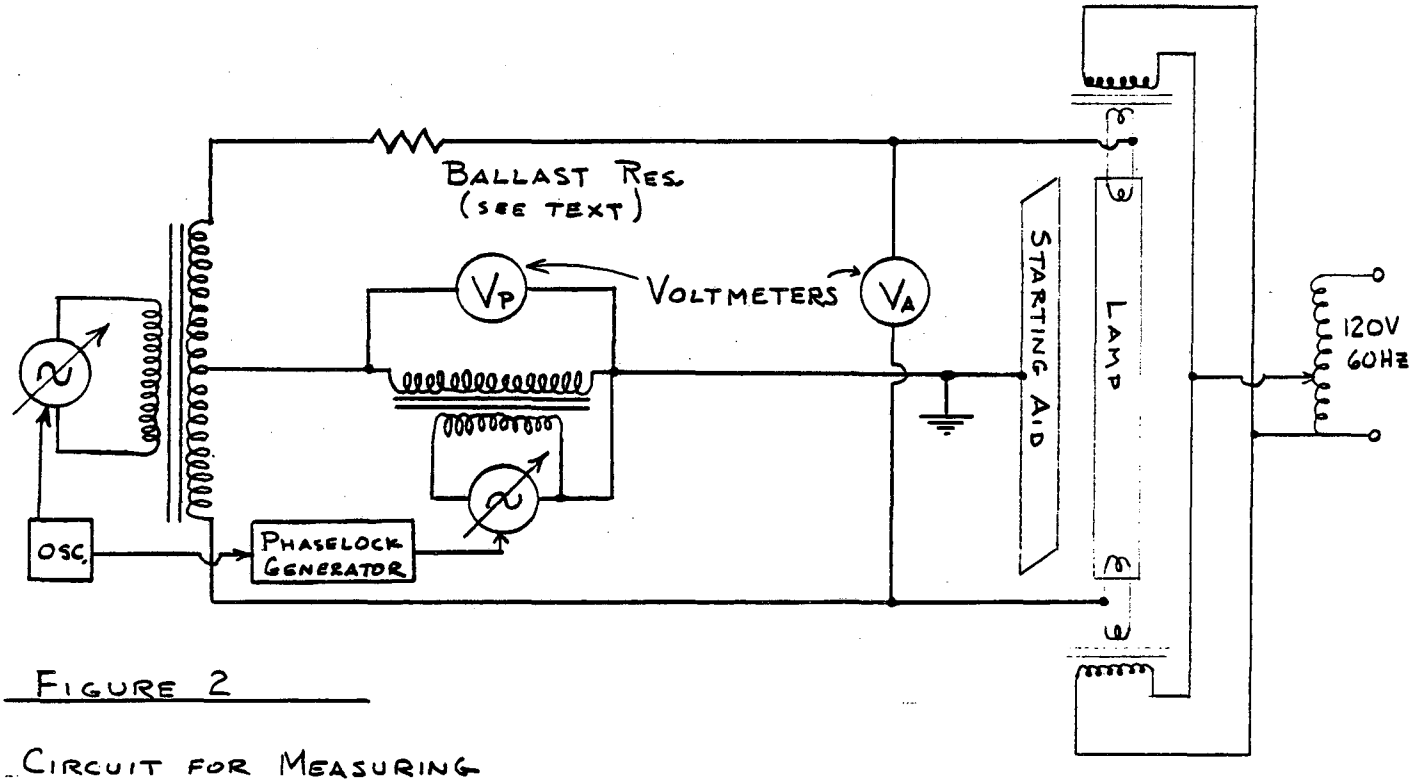

FIGURE 2

CIRCUIT FOR MEASURING RMS BREAKDOWN VOLTAGE (V_A)

GRAPH PAPER GRAPHIC CONTROLS CORPORATION Buffalo, New York Printed in U.S.A. SEMI LOGARITHMIC 5 CYCLES X 70 DIVISIONS AD-0845-60

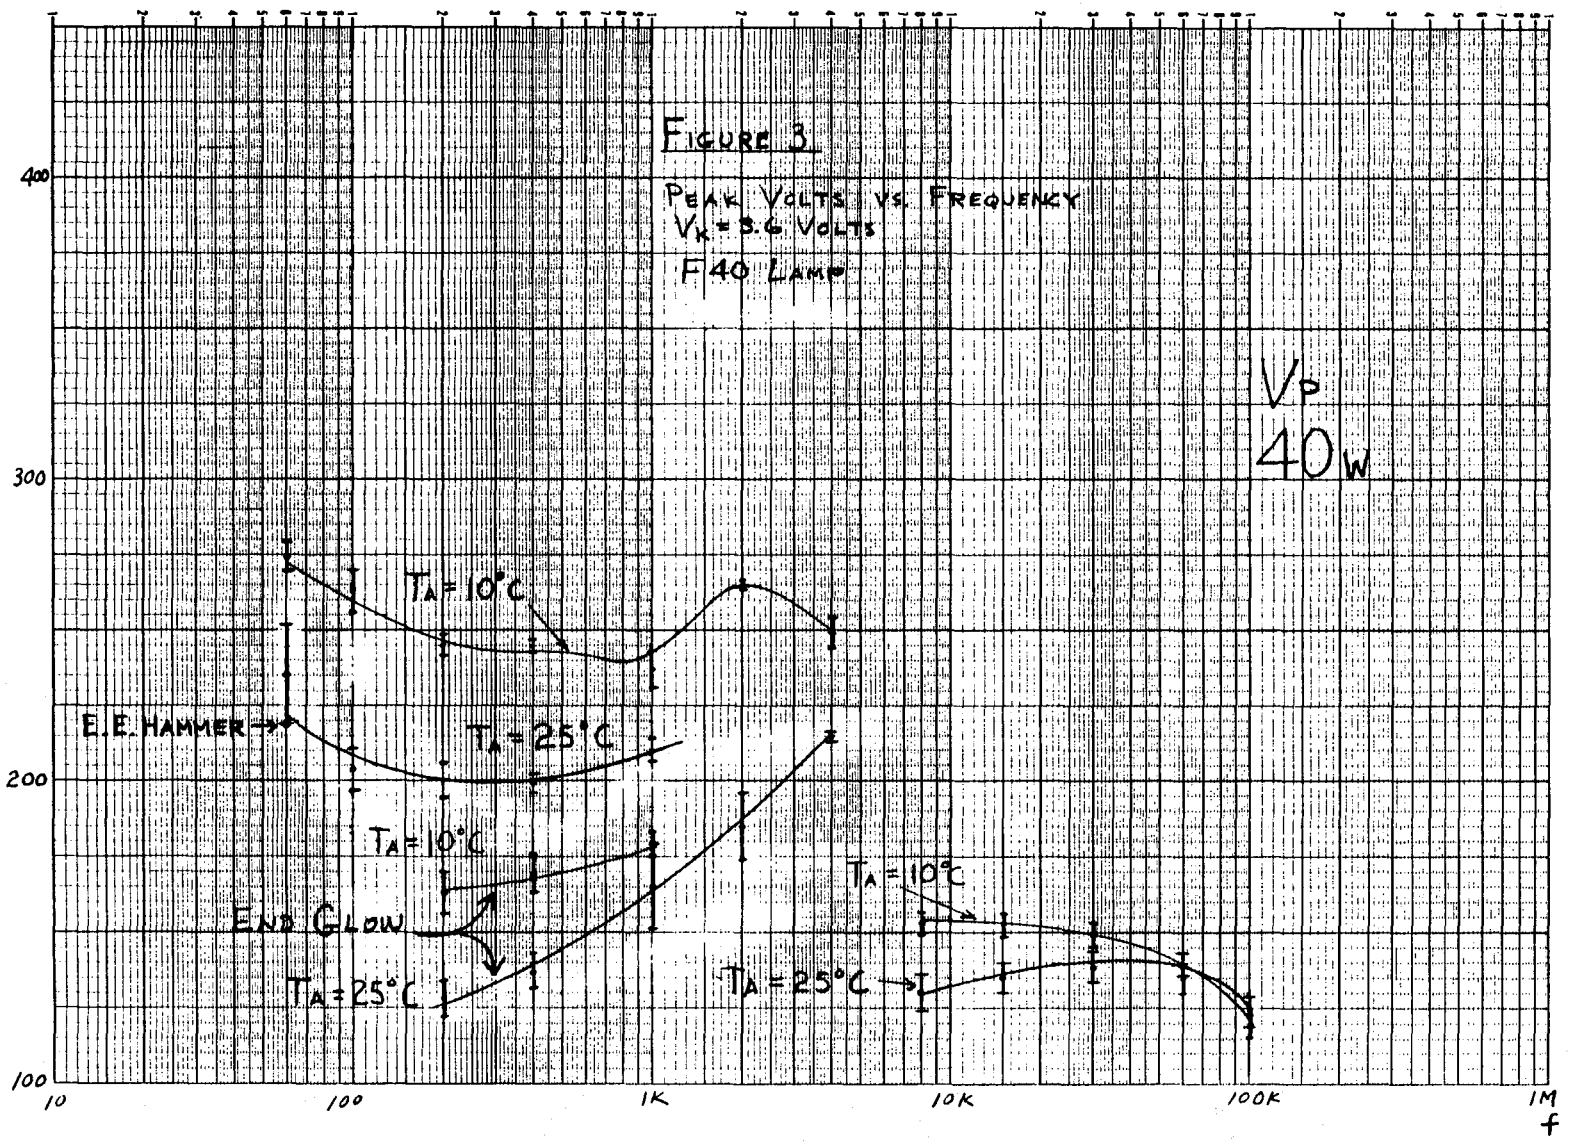

SEMI-LOGARITHMIC 5 CYCLES X 70 DIVISIONS AD 0845 GO

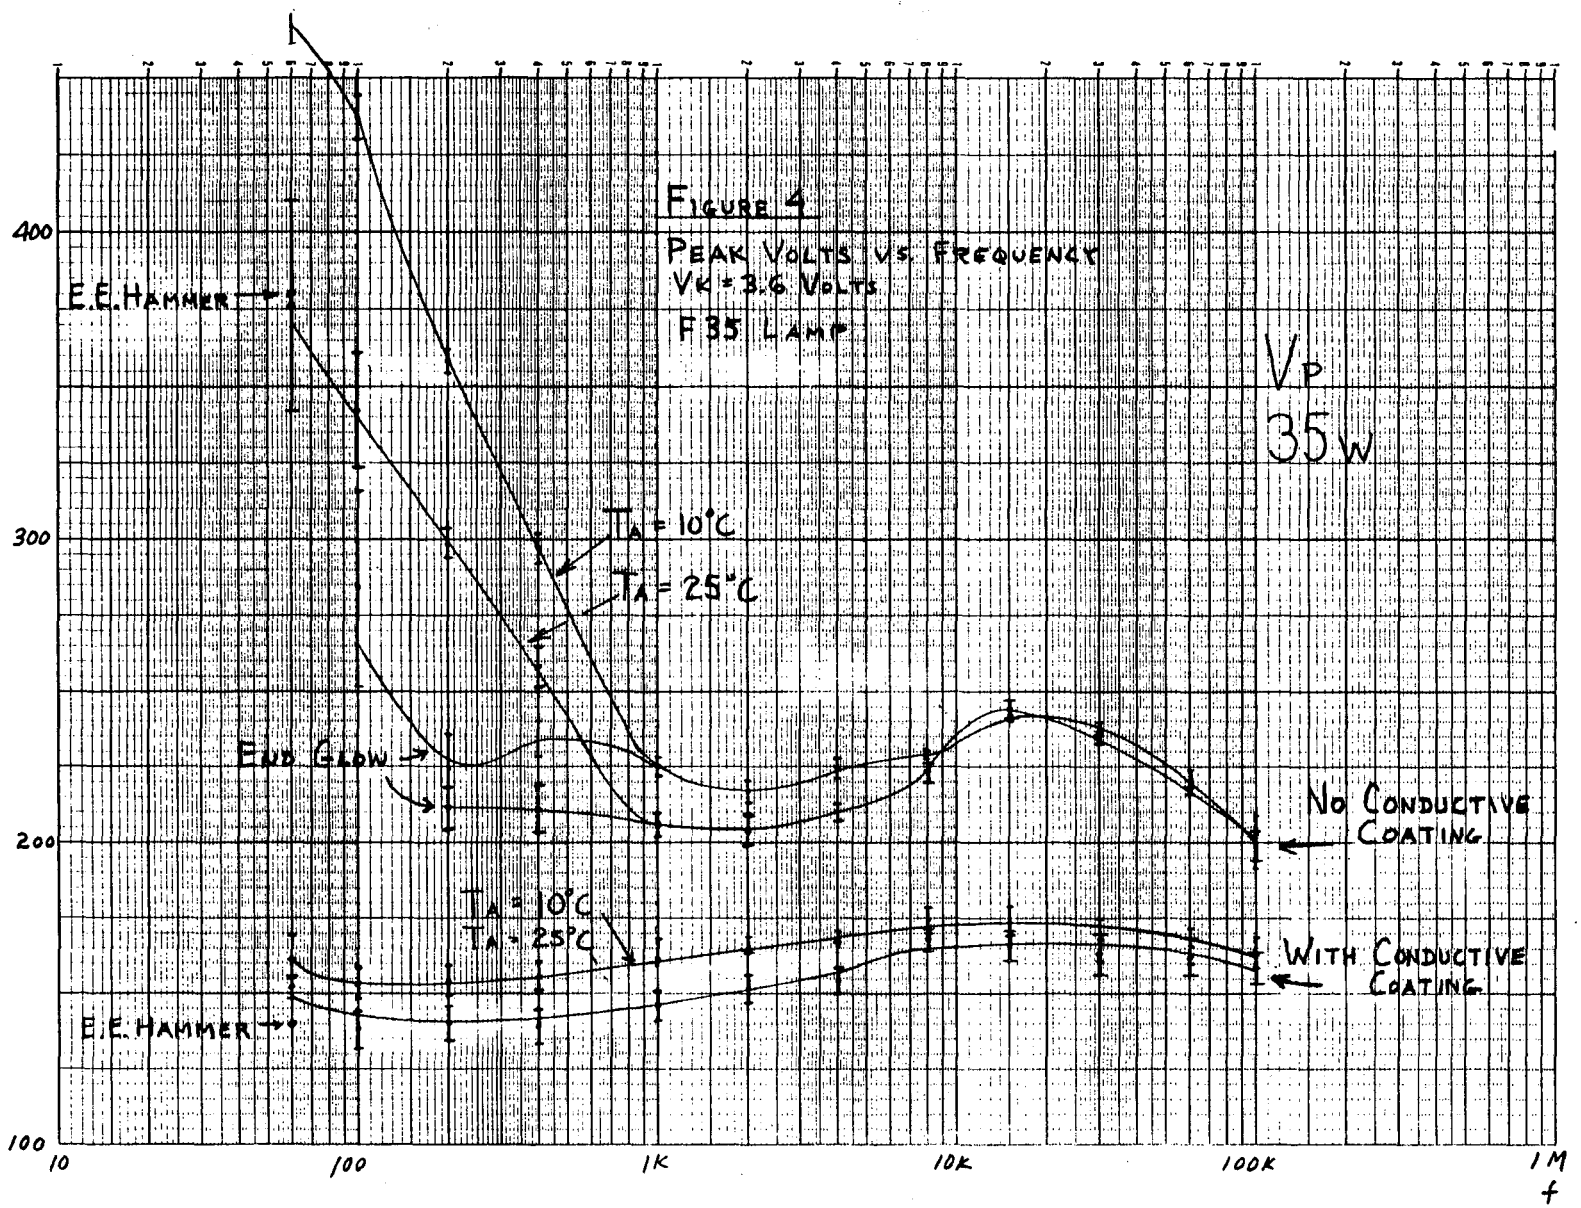

GRAPH PAPER GRAPHIC CONTROLS CORPORATION Buffalo, New York Printed in U.S.A. SEMI-LOGARITHMIC 5 CYCLES X 70 DIVISIONS AD 0845-60

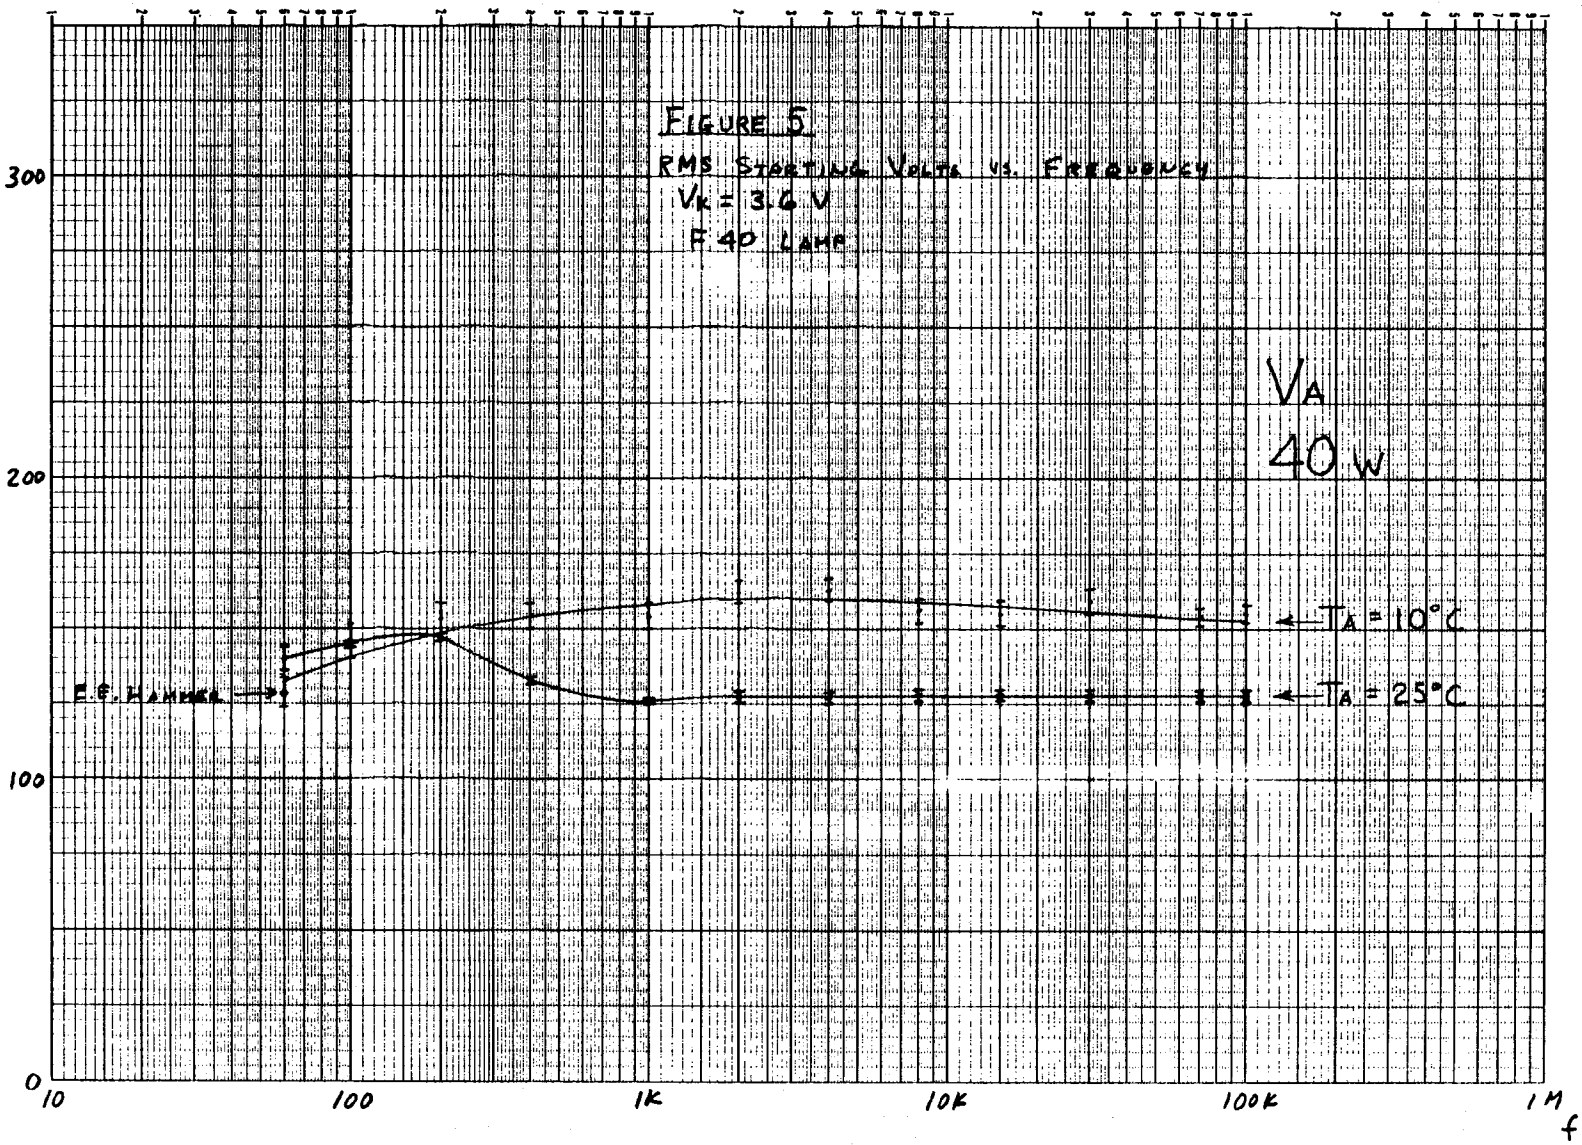

GRAPH PAPER GRAPHIC CONTROLS CORPORATION Buffalo, New York SEMI-LOGARITHMIC 5 CYCLES X 70 DIVISIONS AB-0845 -60
Printed in U.S.A.

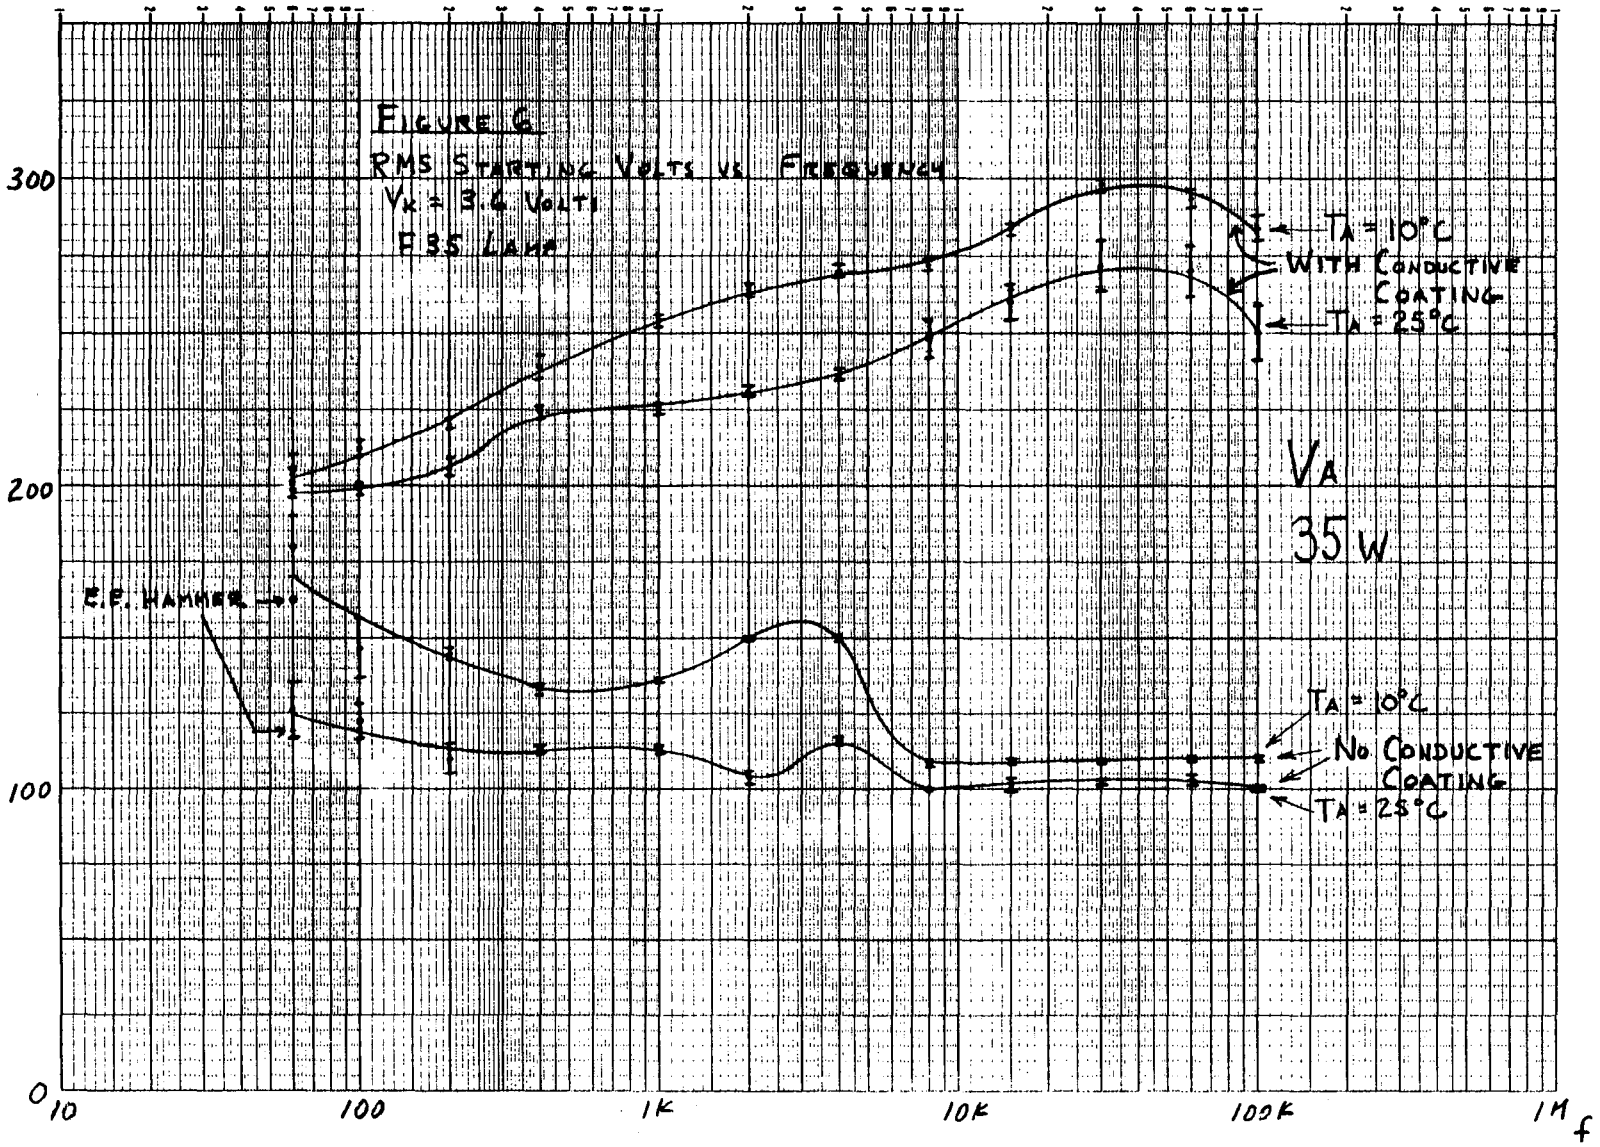

APPENDIX 1

Apparatus

Mfr.	Apparatus	Application
ENI	EGR-1600 Watt Amplifier	V_A Source 8 kHz -100 kHz
ENI	EGR-800 Watt Amplifier	V_p Source 8 kHz -100 kHz
Dynaco	Mark III 60 Watt Amplifier	V_A Source 100 Hz - 4kHz
Newcomb	E-10B 10 Watt Amplifier	V_p Source 100 Hz - 4kHz
Wavetek	186 Phase Lock Generator	Phase Lock, 100 Hz - 100 kHz
Tektronix	7623A Oscilloscope	Monitor
Clarke-Hess	255 V-A-W Meter (2 ea)	V_A and V_p Monitor

This report was done with support from the Department of Energy. Any conclusions or opinions expressed in this report represent solely those of the author(s) and not necessarily those of The Regents of the University of California, the Lawrence Berkeley Laboratory or the Department of Energy.

Reference to a company or product name does not imply approval or recommendation of the product by the University of California or the U.S. Department of Energy to the exclusion of others that may be suitable.

TECHNICAL INFORMATION DEPARTMENT
LAWRENCE BERKELEY LABORATORY
UNIVERSITY OF CALIFORNIA
BERKELEY, CALIFORNIA 94720